

Surge Arresters

UltraSIL Housed VariSTAR Surge Arresters 5 kA and 10 kA Class 1 IEC 60099-4 for MV Systems to 36 kV

Electrical Apparatus

1235-35

GENERAL

The advantages of polymer housed arresters — reduced size and weight, and enhanced safety — have been refined in this new generation of surge arresters: the UltraSIL housed arrester from Cooper Power Systems.

The UltraSIL housed surge arrester incorporates the industry recognized superior polymeric material — silicone rubber.

Using Metal Oxide Varistors (MOVs) having excellent electrical properties, these arresters provide superior overvoltage protection for MV distribution systems. Manufacturing our own MOV disks allows strict quality control over the manufacturing process from start to finish.

After production, every MOV disk must pass a series of electrical tests designed to ensure the highest individual disk quality. These MOV disks have proven their reliability and protective abilities through years of in-service use.

UltraSIL housed VariSTAR arresters are available in 5 kA and 10 kA Class 1 IEC 60099-4 designs.

CONSTRUCTION

The MOV disks are combined with aluminum end electrodes and are encapsulated in a high-strength composite wrap insulating material on our fully automated assembly line using strict quality control processes that eliminate manufacturing variances. The composite collar is cured to the MOV disk stack to form a solid insulation MOV disk module system that is inserted and bonded to the industry leading track resistant UltraSIL silicone rubber housing. This exclusive Cooper Power Systems patented manufacturing process forms a secondary moisture seal under the primary silicone rubber housing seal, which makes the arrester impervious to moisture and capable of withstanding extreme electrical, environmental and cantilever load conditions. The composite wrapped UltraSIL arrester design represents a quantum leap in polymer arrester technology.

FEATURES

The UltraSIL silicone rubber housing has undergone a wide range of design tests to determine the optimum shed configuration. In addition, long term environmental testing has verified the lifetime superiority of UltraSIL silicone rubber when compared to other polymeric insulating materials.

Independent laboratory tests have verified the superiority of silicone rubber in terms of hydrophobicity, resistance to UV and surface tracking performance in contaminated environments, chemical inertness, temperature stability and other key insulating properties.

UltraSIL silicone rubber will not support biological growth (algae and mildew) and is non-flammable.

A ground lead disconnecter is optionally available for use on systems having 20A or more of available fault current. The disconnecter will sense and disconnect the ground terminal in the unlikely event of arrester failure, preventing a permanent system short circuit. A disconnecter that has operated gives a visual indication of internal arrester damage and the need for arrester replacement. See Figure 8 for the disconnecter operating characteristics.

OPERATION

The operation of the VariSTAR arrester is typical of gapless metal oxide arresters. During steady state conditions, line-to-ground voltage is continuously across the arrester



Figure 1.
10 kV UltraSIL housed VariSTAR surge arrester (shown with optional features).

terminals. When overvoltages occur, the VariSTAR arrester immediately limits the overvoltage to the required protective level by conducting only the necessary level of surge current to earth. Upon passage of the overvoltage condition, the arrester returns to its initial condition once again, conducting only minimal leakage current.

Arrester Type	UNS	UHS
System Application Voltages	3-36 kV	3-36 kV
Rated Arrester Voltages, U_r	3-36 kV	3-36 kV
Power System Frequency	50-60 Hz	50-60 Hz
Applicable Design and Test Standard	IEC 60099-4	IEC 60099-4
Nominal Discharge Current	5 kA	10 kA
Line Discharge Class	–	1
High Current Withstand	65 kA	100 kA
Pressure Relief Class	20 kA (rms Sym.) (B)	20 kA (rms Sym.) (B)
Maximum Energy, Square Wave (Repeatable 1 min)	1.83 kJ/kV U_C	2.85 kJ/kV U_C
High Current, Short Duration Energy Handling	(65 kA) 3.17 kJ/kV U_C	(100 kA) 3.9 kJ/kV U_C

Features and Detailed Description

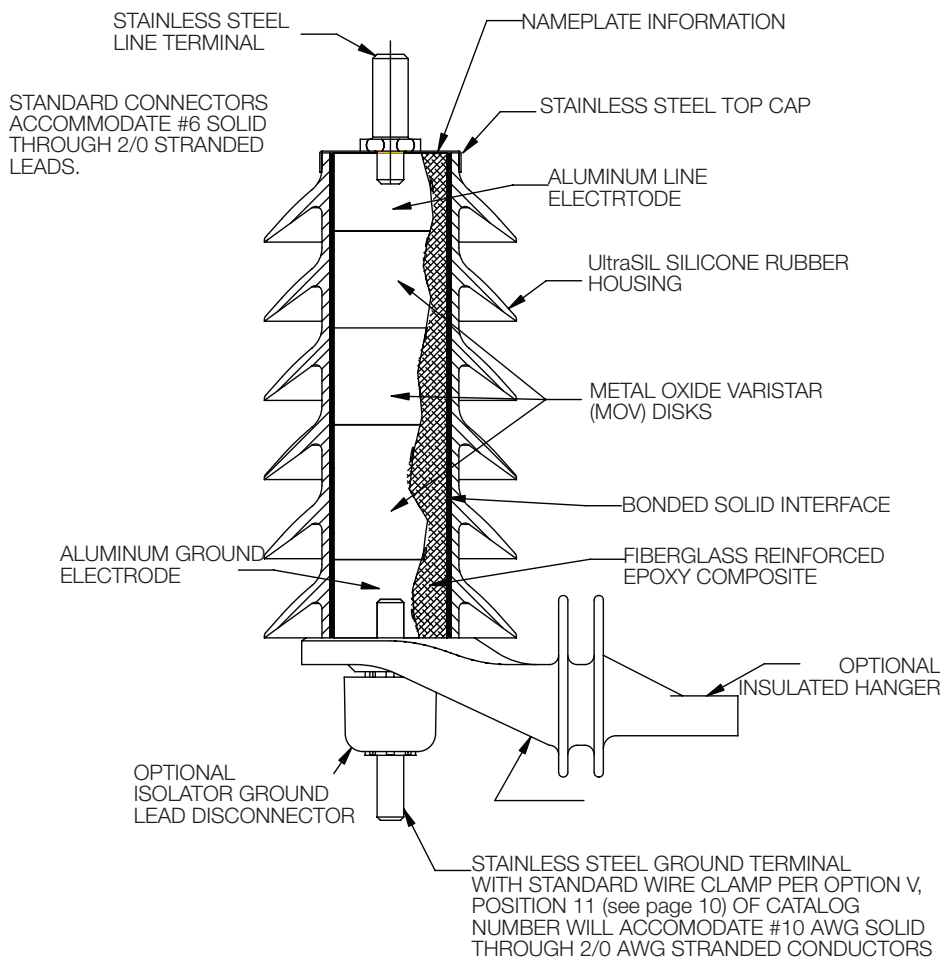


Figure 2.
Cutaway illustration of an UltraSIL housed VariSTAR arrester.

DESIGN TESTING

The housing material, internal components and hardware work as a system and stand up to years of exposure to environmental extremes. To assure a superior level of performance, the components and the assembled arrester units have been subjected to a testing program that accurately simulates years of exposure to field conditions. Tests include:

- IEC 60099-4 Testing – Full certification to performance requirements by an independent laboratory has been completed. A certified test report is available. Refer to Table 9.

Additional design verification of the UltraSIL housed arrester includes testing for:

- UV Withstand
- High Voltage Dielectric Integrity
- Wet Arc Tracking Resistance
- Thermal Shock
- Multi-stress Environmental Test and Cycling
- Coefficients of Expansion and Materials Compatibility
- Cantilever Strength
- Terminal and Disconnecter Torque

This is only a partial listing of the comprehensive design tests performed

on the UltraSIL arrester.

ROUTINE TESTS

A complete automated production test program ensures a quality product. Each metal oxide varistor receives a series of electrical tests. Quality is further demonstrated by tests performed to destruction on samples from every lot of varistors.

Listed are the varistor tests performed in accordance with IEC 60099-4:

- Physical Inspection
- Discharge Voltage
- $V1\text{mA}/\text{cm}^2$
- Leakage Current at 80% of $V1\text{mA}/\text{cm}^2$ Voltage
- High Current, Short Duration Withstand
- Thermal Stability
- Aging

Each fully assembled VariSTAR arrester must pass the following routine tests:

- Physical Inspection
- Reference Voltage Test
UNS $I_{\text{ref}} = 3\text{ mA}$
UHS $I_{\text{ref}} = 4\text{ mA}$
- Partial Discharge Test
@ $1.05 \times U_c \leq 10\text{ pc}$

GENERAL APPLICATION RECOMMENDATIONS

The rating of an arrester is the maximum power frequency line-to-ground voltage at which the arrester is designed to pass the IEC operating duty test. Table 1 provides a *general* application guide for the selection of the proper arrester rating for a given system voltage and system grounding configuration.

Gapless surge arresters must be selected with sufficient steady-state self impedance to withstand the application of line-to-earth power frequency voltages under all system conditions of operation.

Continuous Voltage

A preliminary selection that is based on selecting an arrester having a "Continuous Operating Voltage", or U_c , that equals or exceeds the normal system *maximum* line-to-earth operating voltage is made. Reference IEC 60099-5.

Power-Frequency Overvoltages

The second application criterion to be met is a condition established by the effectiveness of system grounding. During a single line-to-earth fault, under maximum system voltage conditions, the arrester selected should have a "Rating" (U_r) that will not be exceeded by the voltages on the unfaulted phases at the point of arrester application. One must pay particular attention to systems having low coefficients of grounding, ungrounded systems and systems that are resonant grounded or that may become ungrounded under abnormal conditions of operation. This second voltage consideration may be modified for various system conditions as long as the application does not violate the selected arrester's "Temporary Overvoltage Capability (TOV)" (see Figure 3).

Temporary system conditions resulting in *sinusoidal power-frequency voltages* that exceed arrester "Continuous Operating Voltage, (U_c)" or even "Arrester Rating, (U_r)" can be allowed. Consider the permissible magnitude and duration of these overvoltages (including the full time of system back-up protection), with appropriate allowances for any recent arrester discharge energies.

The voltage withstand capability application on ungrounded systems is 1.035 per unit of COV (U_c) for 24 hours. Systems which permit earth faults to remain undetected or operate with one phase earthed for periods in excess of 24 hours will require the use of an arrester having a U_c (continuous capability) equal to the system maximum phase-to-phase voltage.

Under some special system conditions, such as transformer energization using certain types of connections and ferroresonance, higher voltages can be experienced by the arrester. To ensure that the arrester's capabilities will not be exceeded, the resources of the Thomas A. Edison Technical Center and their systems application engineers are available to make recommendations.

Consult with your Cooper representative to have your individual system application needs studied.

TABLE 1
Commonly Applied Voltage Ratings (U_r) of VariSTAR Arresters

System Voltage (kV rms)		Arrester Rating – U_r (kV rms)		
Nominal	Maximum	Four-Wire Star Multi-Grounded Neutral	Three-Wire Star Solidly Grounded Neutral at Source	Delta, Ungrounded, & Resonant Impedance Grounded Star
3.3	3.7	3	6	6
6.6	7.3	6	9	9
10.0	11.5	9	12	12-15
11.0	12.0	9-10	12	12-15
16.4	18.0	15	-	18-21
22.0	24.0	18-21	24	24-27
33.0	36.3	27-30	36	36-36

PERFORMANCE TEST CHARACTERISTICS

UltraSIL housed VariSTAR arresters meet the following design tests as described by IEC 60099-4:

■ Operating Duty Test:

UNS – twenty (20) current surges of 5 kA, 8/20 μ s waveshape followed by two (2) high current surges of 65 kA crest (4/10 μ s).

UHS – twenty (20) current surges of 10 kA, 8/20 μ s waveshape followed by two (2) high current surges of 100 kA crest (4/10 μ s).

■ Long Duration Current Impulse Withstand Test:

UNS – eighteen (18) current surges of 75 A, 1000 μ s duration.

UHS – eighteen (18) current surges of the energy associated with the line parameters for IEC Class 1 performance (approximately 250 A, 2000 μ s).

Following each of these tests, the arresters remain thermally stable as verified by:

- Continually decreasing leakage current values during a thirty minute power monitoring period when energized at U_c .
- No evidence of physical or electrical deterioration.
- The I_N (5 kA or 10 kA) discharge voltage measured after each test changed less than 5% from the initial values.

Full IEC 60099-4 certification has been completed and independently verified.

PRESSURE RELIEF (FAULT CURRENT WITHSTAND TESTS)

These tests demonstrate the ability to withstand fault currents for specific durations.

All UltraSIL housed arresters have been tested in accordance with the requirements listed in IEC 60099-4 and are non-fragmenting to the levels shown in Table 2.

TABLE 2
Pressure Relief Tests

Arrester Type	IEC Pressure Relief Class	Fault Current Amplitude (kA rms) Sym.	Minimum Fault Current Duration (Seconds)
UNS/ UHS	B	0.8 20	0.5 0.2

**TEMPORARY
OVERVOLTAGE (TOV)
CAPABILITY
(POWER FREQUENCY
WITHSTAND VOLTAGE
VERSUS TIME
CHARACTERISTIC)**

The ability to withstand system power frequency overvoltage conditions is shown in Figure 3. The graph shows for a given voltage magnitude (on a per unit of U_C basis), the time an arrester can survive a temporary power frequency overvoltage condition and recover without thermal runaway.

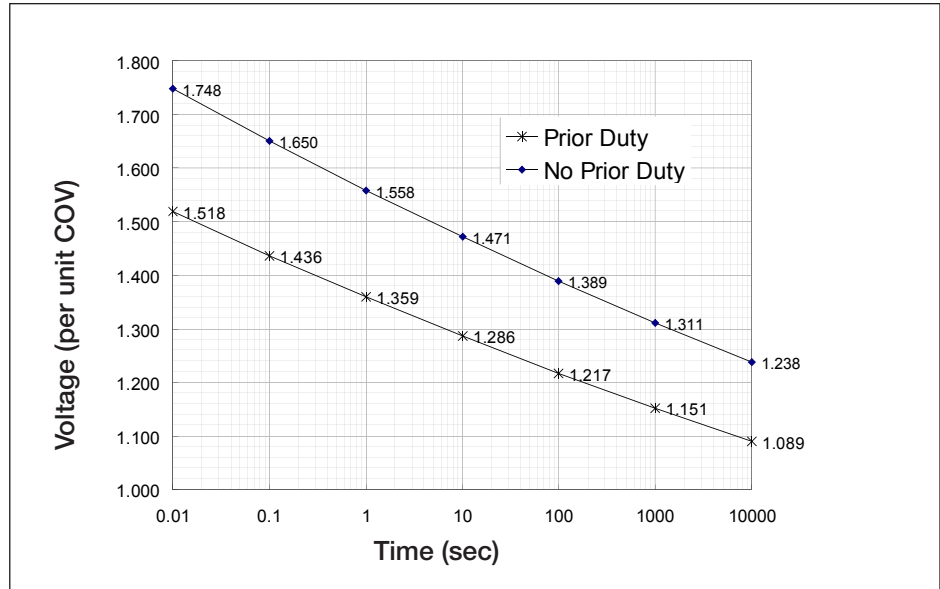


Figure 3. Temporary Overvoltage Capability (followed by U_C), 60° C ambient, UNS and UHS. The 24 hour TOV without prior duty is 1.173 per unit of U_C . The 24 hour TOV with prior duty is 1.035 per unit of U_C .

**PROTECTIVE
CHARACTERISTICS**

UltraSIL arresters provide excellent overvoltage protection for electrical equipment throughout the MV distribution system.

The protective characteristics of the UltraSIL housed arrester family are shown in Tables 3 and 4.

TABLE 3
Protective Characteristics – VariSTAR UNS, $I_N = 5$ kA IEC 60099-4

U_r Arrester Rating (kV rms)	U_C COV (kV rms)	Steep Current Residual Voltage (kV Crest)	Lightning Impulse Residual Voltage (kV Crest) 8/20 μ s Current Wave					
			1.5 kA	3 kA	5 kA	10 kA	20 kA	40 kA
3	2.55	10.9	9.0	9.7	10.4	11.4	13.0	15.1
6	5.1	21.8	17.9	19.4	20.8	22.7	26.0	30.2
9	7.65	31.4	25.8	28.0	30.0	32.8	37.4	43.5
10	8.4	32.7	26.9	29.1	31.2	34.1	38.9	45.3
12	10.2	41.1	33.8	36.5	39.2	42.9	48.9	56.9
15	12.7	51.3	42.2	45.7	49.0	53.6	61.1	71.1
18	15.3	61.6	50.6	54.8	58.8	64.3	73.4	85.3
21	17.0	65.4	53.7	58.2	62.4	68.2	77.9	90.6
24	19.5	76.3	62.7	67.8	72.8	79.6	90.8	106.0
27	22.0	86.3	71.0	76.8	82.4	90.1	103.0	120.0
30	24.4	96.2	79.1	85.6	91.8	100.0	115.0	133.0
33	27.0	107.0	87.8	95.6	102.0	112.0	127.0	148.0
36	29.0	115.0	94.7	103.0	110.0	120.0	137.0	160.0

TABLE 4
Protective Characteristics – VariSTAR UHS, I_N = 10 kA, Class 1 IEC 60099-4

UltraSil HD Star		1/2 Wave	8/20 Wave Forms						30/60 Switching Surge	
Rating	MCOV	(kV, peak) 10 kA	(kV, peak) 1.5 kA	(kV, peak) 3 kA	(kV, peak) 5 kA	(kV, peak) 10 kA	(kV, peak) 20 kA	(kV, peak) 40 kA	(kV, peak) 125 A	(kV, peak) 500 A
3	2.55	10.8	8.2	8.7	9.1	9.9	10.9	12.3	7.1	7.6
6	5.1	21.5	16.3	17.4	18.2	19.8	21.9	24.7	14.1	15.1
9	7.65	32.4	24.6	26.1	27.3	29.8	33.0	37.1	21.3	22.7
10	8.4	34.4	26.0	27.7	29.0	31.6	34.9	39.4	22.6	24.1
12	10.2	43.2	32.7	34.8	36.4	39.7	43.9	49.5	28.3	30.3
15	12.7	52.2	39.6	42.1	44.0	48.0	53.1	59.8	34.3	36.6
18	15.3	64.8	49.1	52.3	54.7	59.6	65.9	74.2	42.6	45.5
21	17	68.8	52.1	55.4	58.0	63.2	69.9	78.7	45.1	48.2
24	19.5	79.5	60.2	64.1	67.0	73.1	80.8	91.1	52.2	55.8
27	22	92.4	70.0	74.5	77.9	84.9	93.9	106	60.6	64.8
30	24.4	100.5	76.1	81.0	84.7	92.4	102	115	66.0	70.5
33	27	114.2	86.5	92.1	96.3	105	116	131	75.0	80.1
36	29	120.8	91.5	97.3	102	111	123	138	79.3	84.7

INSULATION WITHSTAND CHARACTERISTICS

TABLE 5
Housing Insulation Withstand Voltages, U_r 3-36 kV, UNS and UHS, I_N = 5 & 10 kA Class 1

Arrester Mounting Configuration	Arrester Housing Designation (Digits 6 & 7)	Leakage Distance (mm)	Strike (mm)	105 mm			127 mm			105 mm			127 mm			105 mm		
				1.2/50µs Impulse (kV Crest)	1 min. Dry (kV rms)	1 min. Wet (kV rms)	1.2/50µs Impulse (kV Crest)	1 min. Dry (kV rms)	1 min. Wet (kV rms)	1.2/50µs Impulse (kV Crest)	1 min. Dry (kV rms)	1 min. Wet (kV rms)	1.2/50µs Impulse (kV Crest)	1 min. Dry (kV rms)	1 min. Wet (kV rms)	1.2/50µs Impulse (kV Crest)	1 min. Dry (kV rms)	1 min. Wet (kV rms)
	03	183	79	78	47	23	92	50	36	70	44	22	85	53	29	70	42	23
	04	256	106	91	56	34	105	55	38	79	52	33	99	56	37	82	51	33
	05	330	133	104	64	43	117	63	51	89	55	42	109	60	49	90	62	45
	06	404	159	117	78	55	126	86	57	93	61	48	119	80	58	97	72	55
	07	477	186	129	87	66	137	96	68	98	62	51	122	81	60	107	81	66
	08	551	213	140	96	77	148	106	79	104	65	55	126	82	65	118	89	78
	09	625	239	-	-	-	159	116	90	-	-	-	130	83	70	129	98	89
	10	698	266	-	-	-	171	126	100	-	-	-	136	86	75	140	106	99
	11	772	293	-	-	-	183	135	111	-	-	-	142	90	80	152	114	109
	12	846	320	-	-	-	195	144	121	-	-	-	149	94	86	164	122	119
	13	919	346	-	-	-	207	153	131	-	-	-	158	99	92	177	130	128
	14	993	373	-	-	-	220	161	140	-	-	-	167	105	98	190	138	137
	15	1067	400	-	-	-	233	170	150	-	-	-	177	112	105	204	146	146
	16	1140	426	-	-	-	246	178	159	-	-	-	187	120	112	218	154	154
	17	1214	453	-	-	-	259	185	168	-	-	-	199	128	120	233	161	162
	18	1288	480	-	-	-	-	-	-	-	-	-	-	-	-	248	169	169
	19	1361	506	-	-	-	-	-	-	-	-	-	-	-	-	264	178	176
	20	1435	533	-	-	-	-	-	-	-	-	-	-	-	-	280	184	183
	21	1509	560	-	-	-	-	-	-	-	-	-	-	-	-	296	191	189

TABLE 5a
Insulation Withstand Characteristics of Optional Insulated Mounting Bracket

Insulated Mounting Bracket	Bracket Mounting Length Center-to-Center (mm)	Leakage Distance (mm)	Strike (mm)	Power Frequency Voltage Withstand (60 sec, Wet, kV)	1.2/50 μ s Impulse (kV Crest)
Standard For $U_r = 3 - 10$ kV	105	150	71	36	70
Standard For $U_r = 12 - 36$ kV	127	226	99	48	80

DIMENSIONS AND CLEARANCES

Outline drawings for common options are shown. Dimensions (shown in mm) for these arrangements are listed in Table 6.

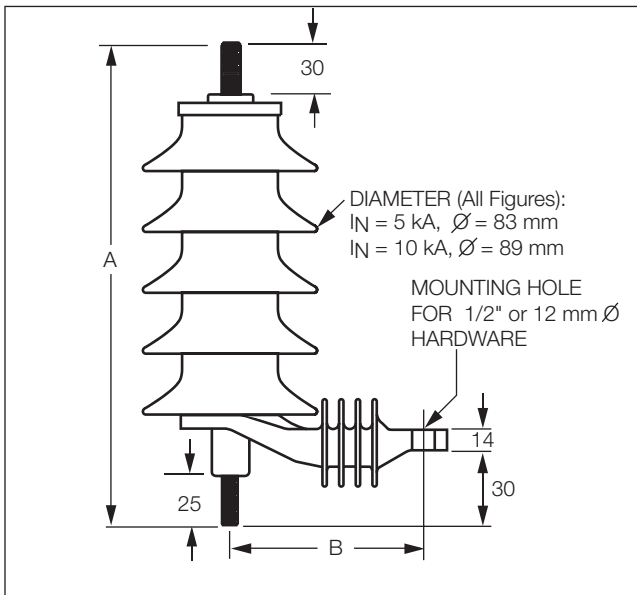


Figure 4.
 UltraSIL housed arrester – with optional insulated mounting bracket, and disconnecter.

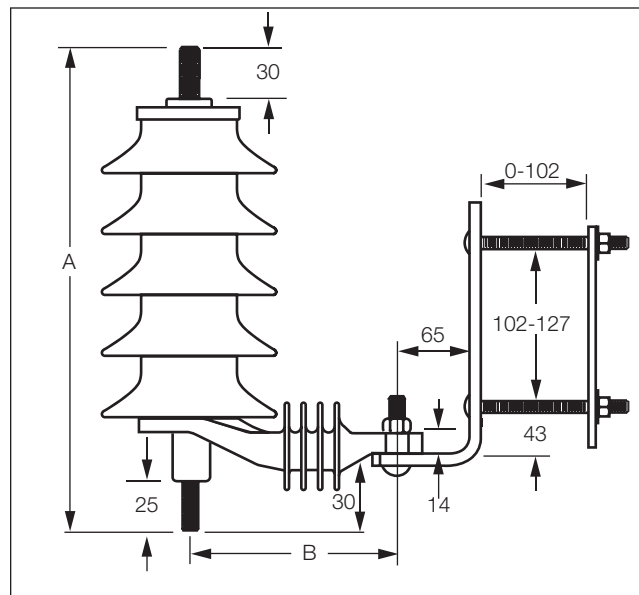


Figure 5.
 UltraSIL housed arrester as in Figure 4 with NEMA crossarm hanger, see Figure 9.

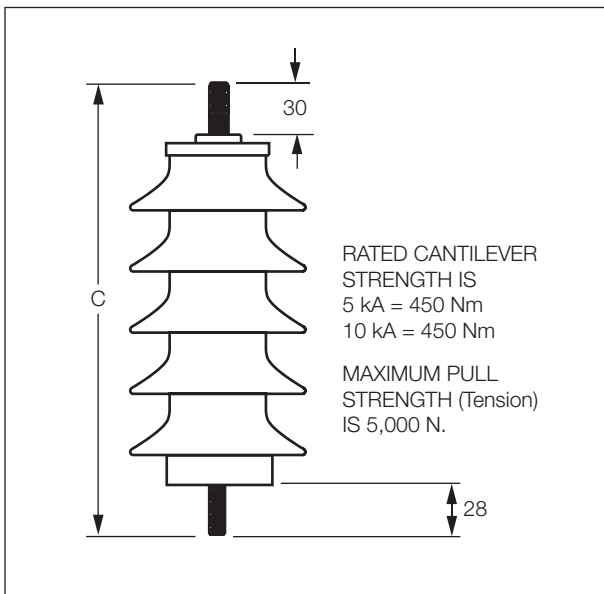


Figure 6.
 UltraSIL housed arrester without disconnecter, for base or cable riser mounting (arrester may be horizontal or vertical with either end at line potential).

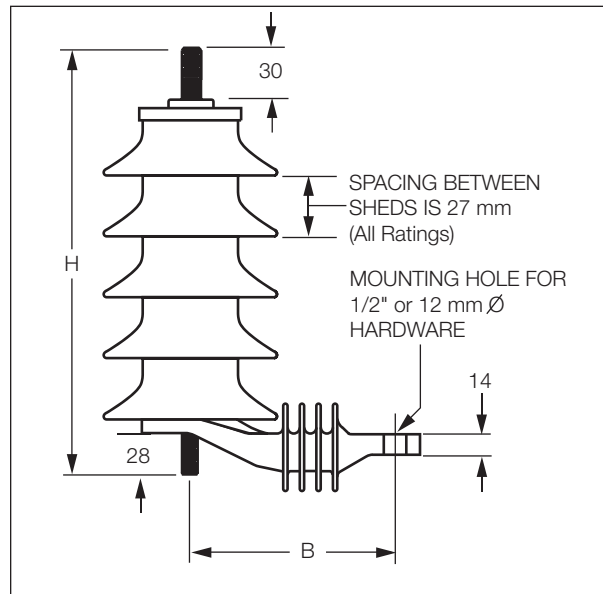


Figure 7.
 UltraSIL housed arrester – with optional disconnecter mounting bracket (no disconnecter).

TABLE 6
Dimensional Data – UNS and UHS
UltraSIL Housed VariSTAR Arresters

U _r	Housing Designation (Digits 6 & 7)	Dimensions - Figures (mm)			
		A	B	C	H
3-10	03	162	105	146	140
	04	190	105	174	168
	05	218	105	202	196
	06	246	105	230	224
	07	272	105	255	249
	08	300	105	283	277
12-36	06	246	127	230	224
	07	272	127	255	249
	08	300	127	283	277
	09	325	127	308	302
	10	353	127	336	330
	11	381	127	364	358
	12	406	127	390	384
	13	434	127	418	412
	14	462	127	446	440
	15	488	127	471	465
	16	-	-	499	-
	17	-	-	527	-
	18	-	-	555	-
	19	-	-	583	-
	20	-	-	611	-
21	-	-	639	-	

TABLE 7
Minimum Recommended
Clearances

U _r Arrester Rating (kV rms)	Clearances* Minimum Recommended (mm)			
	UNS I _N = 5 kA		UHS I _N = 10 kA	
	Phase-to-Ground	Phase-to-Phase	Phase-to-Ground	Phase-to-Phase
3	70	95	76	108
6	95	127	102	140
9	127	165	133	178
10	127	165	133	178
12	146	184	152	197
15	165	210	171	222
18	229	273	235	286
21	229	273	235	286
24	267	324	273	337
27	267	324	273	337
30	267	324	273	337
33	318	400	324	413
36	318	400	324	413

* All clearances are measured between centerlines of arresters or from centerline to earth.

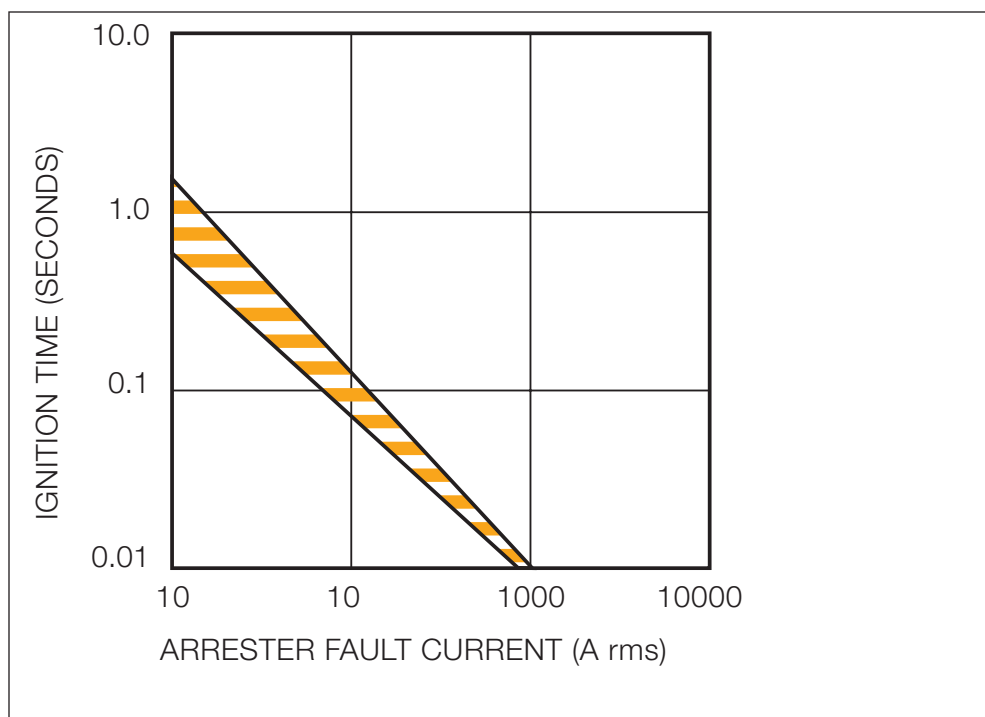


Figure 8.
UltraSIL arrester disconnector operating characteristic.

TABLE 8
UltraQUIK Catalog Numbering System

ULTRAQUIK SELECTION AND ORDERING GUIDE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
U		S												

Catalog Number Digits:

1 = "U", UltraSIL Housed Arrester

2 = Arrester Class: **N** = I_N = 5 kA (U_r = 3 to 36 kV) **H** = I_N = 10 kA, Class 1 (U_r = 3 to 36 kV)

3 = Arrester Type: **S** = VariSTAR, Gapless MOV Surge Arrester

4 & 5 = Arrester Rating: U_r (U_c)

03 = 3 kV (2.55 kV)	12 = 12 kV (10.2 kV)	24 = 24 kV (19.5 kV)	36 = 36 kV (29.0 kV)
06 = 6 kV (5.1 kV)	15 = 15 kV (12.7 kV)	27 = 27 kV (22.0 kV)	
09 = 9 kV (7.65 kV)	18 = 18 kV (15.3 kV)	30 = 30 kV (24.4 kV)	
10 = 10 kV (8.4 kV)	21 = 21 kV (17.0 kV)	33 = 33 kV (27.0 kV)	

6 & 7 = Housing Options – Select from Table below.

AVAILABLE HOUSINGS BY ARRESTER RATING

***** = Standard Housing

O = Housing Options

Digits 6 & 7	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21
Total Leakage Distance (mm)	183	256	330	404	477	551	625	698	772	846	919	993	1067	1140	1214	1288	1361	1435	1509
U _r Arrester Rating (kV rms)																			
3	*	O																	
6		*	O	O															
9			*	O	O	O													
10			*	O	O	O													
12				*	O	O	O	O											
15					*	O	O	O	O	O									
18						*	O	O	O	O	O								
21							*	O	O	O	O								
24								*	O	O	O	O	O	O					
27									*	O	O	O	O	O	O	O			
30										*	O	O	O	O	O	O	O	O	
33											*	O	O	O	O	O	O	O	O
36												*	O	O	O	O	O	O	O

Notes:
 1. Protected leakage distance is approximately 45% of total leakage distance (mm).
 2. Total leakage distance shown includes 40 mm of the insulated base/mounting bracket.

8 = Line Stud and Lead Options:

- 12 mm Line Terminal Options – all threaded studs are 12 mm x 30 mm long (except options L and M), stainless steel.

A = without line lead

- | | | |
|---|--|---|
| B = with 300 mm long, 5 mm diameter insulated lead wire | E = with 450 mm long, 5 mm diameter insulated lead wire | H = with 750 mm long, 5 mm diameter insulated lead wire |
| C = with 300 mm long, 5 mm diameter insulated lead wire having (1) ring terminal | F = with 450 mm long, 5 mm diameter insulated lead wire having (1) ring terminal | J = with 750 mm long, 5 mm diameter insulated lead wire having (1) ring terminal |
| D = with 300 mm long, 5 mm diameter insulated lead wire having (2) ring terminals | G = with 450 mm long, 5 mm diameter insulated lead wire having (2) ring terminals | K = with 750 mm long, 5 mm diameter insulated lead wire having (2) ring terminals |
| L = with 45 mm long stud, without insulated lead wire (will not allow use of universal wildlife protector) | | M = with 65 mm long stud, without insulated lead wire (will not allow use of universal wildlife protector) |


- 3/8" Line Terminal Options – all threaded studs are 3/8" x 1-3/16" long, stainless steel.

0 = without line lead

- | | | |
|--|--|--|
| 1 = with 12" #6 AWG insulated lead wire | 4 = with 18" #6 AWG insulated lead wire | 7 = with 30" #6 AWG insulated lead wire |
| 2 = with 12" #6 AWG insulated lead wire having (1) ring terminal | 5 = with 18" #6 AWG insulated lead wire having (1) ring terminal | 8 = with 30" #6 AWG insulated lead wire having (1) ring terminal |
| 3 = with 12" #6 AWG insulated lead wire having (2) ring terminals | 6 = with 18" #6 AWG insulated lead wire having (2) ring terminals | 9 = with 30" #6 AWG insulated lead wire having (2) ring terminals |

9 = Line Terminal Accessories

All line terminal accessory hardware is stainless steel (12 mm or 3/8" Ø, as required for digit 8)

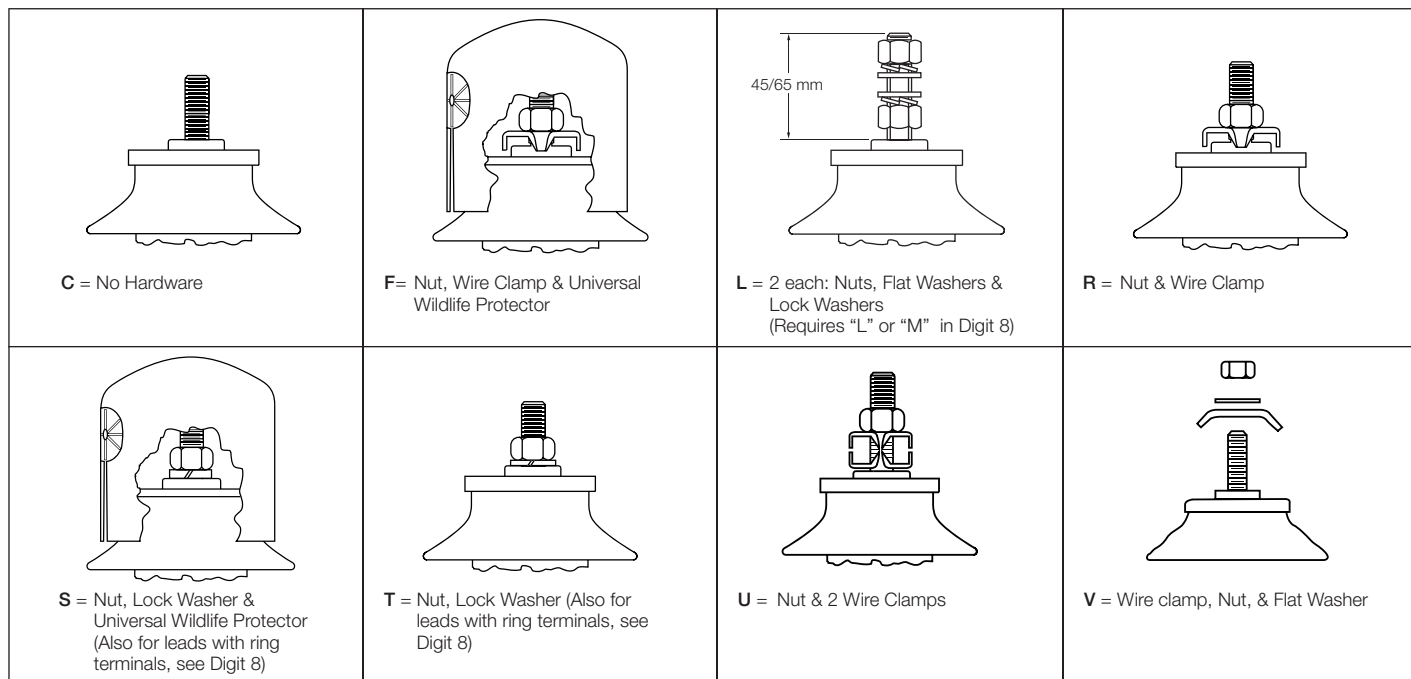

Notes:




1. Wire clamps F R & U will accommodate #10 solid to 2/0 AWG or to 4 mm solid diameter wire. Wire clamp V will accommodate 6 mm solid or up to 14 mm diameter stranded conductor.
2. Maximum allowable torque on line terminal is 27 Nm.
3. The universal wildlife protector may only be used with 30 mm or 1-3/16" length stud.

10 = Ground Terminal Options

- With ground lead disconnector
 - 1** = Isolator with 3/8" x 1" long stainless steel stud (Requires "1" in digit 12)
 - D** = Isolator with 12 mm x 25 mm long stainless steel stud (Requires "1" in digit 12)
- Without ground lead disconnector
 - 0** = Stainless Steel Ground Terminal Stud, 3/8" x 1-3/16" long
 - A** = Stainless Steel Ground Terminal Stud, 12 mm Ø x 30 mm long
 - B** = Stainless Steel Ground Terminal Stud, 12 mm Ø x 45 mm long
 - C** = Stainless Steel Ground Terminal Stud, 12 mm Ø x 65 mm long





11 = Ground Terminal Hardware

All ground terminal accessory hardware is stainless steel (12 mm or 3/8" Ø, as required for digit 10)



		
<p>B = No Hardware (Shown with optional disconnecter and Insulated mounting bracket)</p>	<p>V = Wire Clamp and Nut (Shown with optional disconnecter and Insulated mounting bracket)</p>	<p>W = Washer, Lock Washer, and Nut</p>

Note: Maximum allowable torque on ground terminal is 27 Nm.

12 = Bracket Configurations

			
<p>0 = Base Mounted Arrester</p>	<p>1 = Insulated Mounting Bracket (Required with optional disconnecter) Available only if Digits 6 & 7 are Housing Options 15 or less</p>	<p>2 = Conductive Mounting Bracket For 3/8" Hardware (Requires "0" in Digit 10 and "W" in Digit 11) See Figure 11</p>	<p>3 = Conductive Mounting Bracket For 12 mm Hardware (Requires "A", "B" or "C" in Digit 10 and "W" in Digit 11) See Figure 12</p>

13 = Mounting Options


<p>A = Without a Mounting Bracket</p>

<p>B = NEMA Crossarm Hanger (Mounting Hardware Included) (Requires "1", "2" or "3" in Digit 12) See Figure 9</p>

14 = Nameplate Information, See Figures 13 and 14

Nameplate information is per IEC 60099-4. Auxiliary nameplates are available in the following languages:

- A = English
- B = Español – Mexico
- C = Español – Americas
- D = Português – Americas
- E = Español – Europa
- F = Português – Europa
- G = Polski
- H = Français
- I = Norsk
- J = Suomeksi
- K = Greek
- L = Italiano
- M = Russian

15 = Packaging. See Figure 15

- 1 = Individual carton. Each arrester with accessories is shipped in an individual cardboard carton. Individual cartons are packed within a heavy duty quadwall carton having a skid bottom and suitable for double stacking within an ocean shipping container. See Figure 15 for packing details.
- 2 = Individual carton. Each arrester is shipped in an individual cardboard carton. Individual cartons are stacked on a pallet and shrink wrapped, suitable for shipment within NAFTA. Quantities per pallet may be adjusted to meet shipping requirements.

ACCESSORIES FOR THE UltraSIL ARRESTER

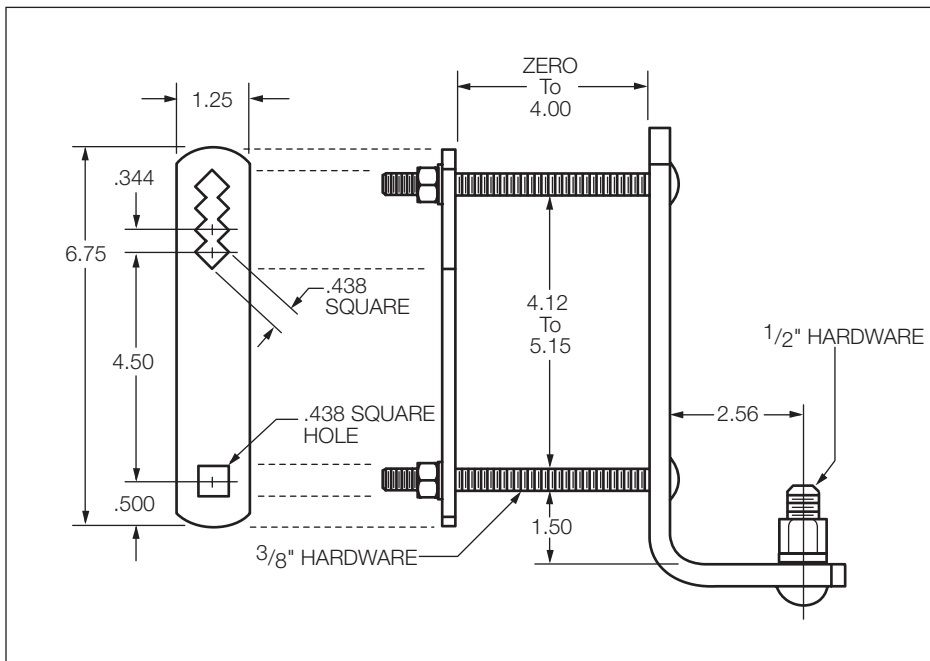


Figure 9.
NEMA crossarm hanger (all dimensions are as required to be in inches, per NEMA.)

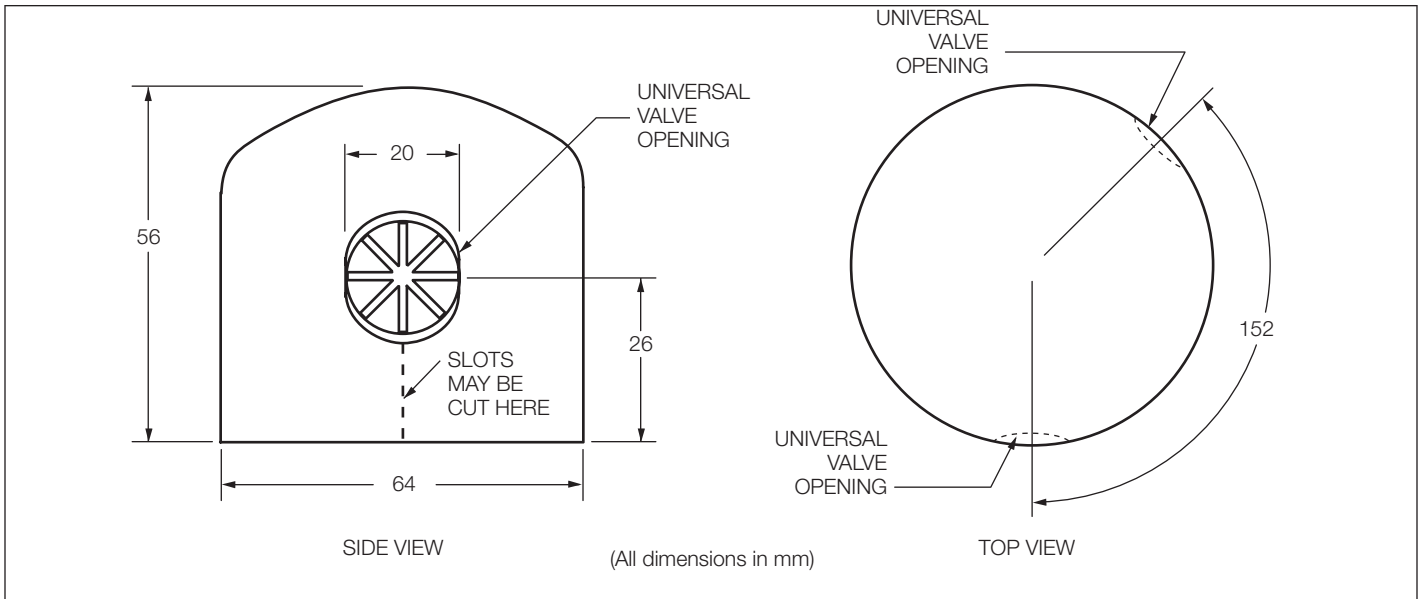


Figure 10. Universal Wildlife Protector (for line terminal) adds 5 mm to arrester height above line terminal stud. To be used only with 3/8" or 12 mm Ø line hardware of standard length, 1-3/16" and 30 mm respectively.

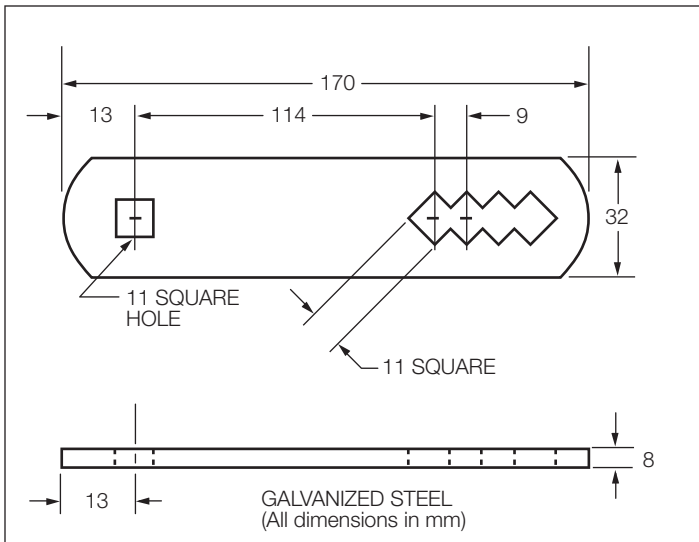


Figure 11. Conductive base mounting for use with 3/8" hardware (requires "0" in digit 10, "W" in digit 11).

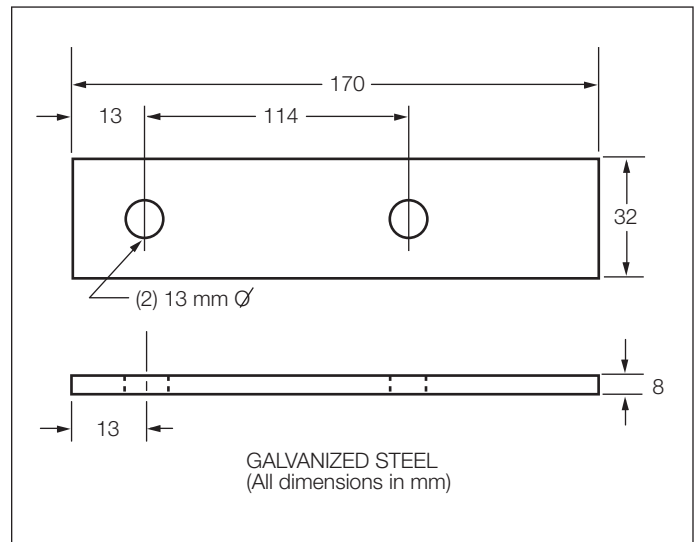


Figure 12. Conductive base mounting for use with 12 mm hardware (requires "A", "B" or "C" in digit 10, "W" in digit 11).

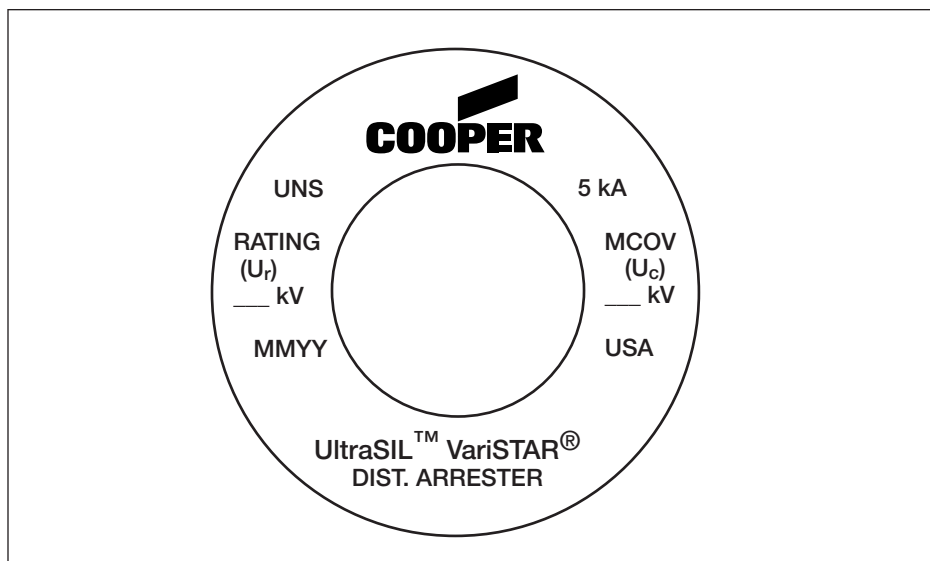


Figure 13.
IN = 5 kA, UNS UltraSIL Nameplate – stamped in stainless steel top cap.

<p>VARISTAR® SURGE ARRESTER ULTRASIL™ TYPE UNS-ZnO In = 5 kA IEC 60099-4 P.R. = 20 kA sym</p> <p>(ENGLISH)</p>	<p>PARARRAYOS VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA CEI 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - EUROPA)</p>
<p>APARTARRAYOS VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA IEC 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - MEXICO)</p>	<p>DESC. DE SOBRET. VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA IEC 60099-4 LdeS = 20 kA sim</p> <p>(PORTUGUE'S - EUROPA)</p>
<p>PARARRAYOS VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA IEC 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - AMERICAS)</p>	<p>OGRANICZNIK PRZEPIEC VARISTAR® ULTRASIL™ TYP UNS-ZnO In = 5 kA IEC 60099-4 Pr = 20 kA sym</p> <p>(POLSKI)</p>
<p>PÁRA-RAIOS VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA IEC 60099-4 Sp = 20 kA sim</p> <p>(PORTUGUE'S - AMERICAS)</p>	<p>PARAFOUDRE VARISTAR® MODÈLE ULTRASIL™ UNS-ZnO In = 5 kA CEI 60099-4 LdP = 20 kA sym</p> <p>(FRANÇAIS)</p>
<p>VARISTAR® OVERSPENNINGSAVLEDER ULTRASIL™ TYPE UNS-ZnO In = 5 kA IEC 60099-4 KORTSLUTTKAP = 20 kA sym</p> <p>(NORSK)</p>	<p>VARISTAR® YLJÄNNITESUOJA ULTRASIL™ TYYPPI UNS-ZnO In = 5 kA IEC 60099-4 RTV = 20 kA sym</p> <p>(SUOMEKSI)</p>
<p>ALEXIKEPAYNO M.T. VARISTAR® TYPOS ULTRASIL™ UNS - ZNO IN = 5 kA KLASH 1 IEC 60099-4 EKT PIES = 20 kA Sym</p> <p>(GREEK)</p>	<p>SCARICATORE M.T. VARISTAR® TIPO ULTRASIL™ UNS-ZnO In = 5 kA CEI 60099-4 P.R. = 20 kA sym</p> <p>(ITALIANO)</p>
<p>VARISTAR® ОГРАНИЧИТЕЛЬ ПЕРЕНАПРЯЖЕНИЯ ULTRASIL™ ТИП ДИСКОВ. ЗНО Масса кг КЛАСС=5 кА МЭК 60099-4 СБРОС ДАВЛ. = 20 кА, СИМ.</p> <p>(RUSSIAN)</p>	

Figure 13a.
IN = 5 kA, UNS UltraSIL Arrester Auxiliary Nameplates.

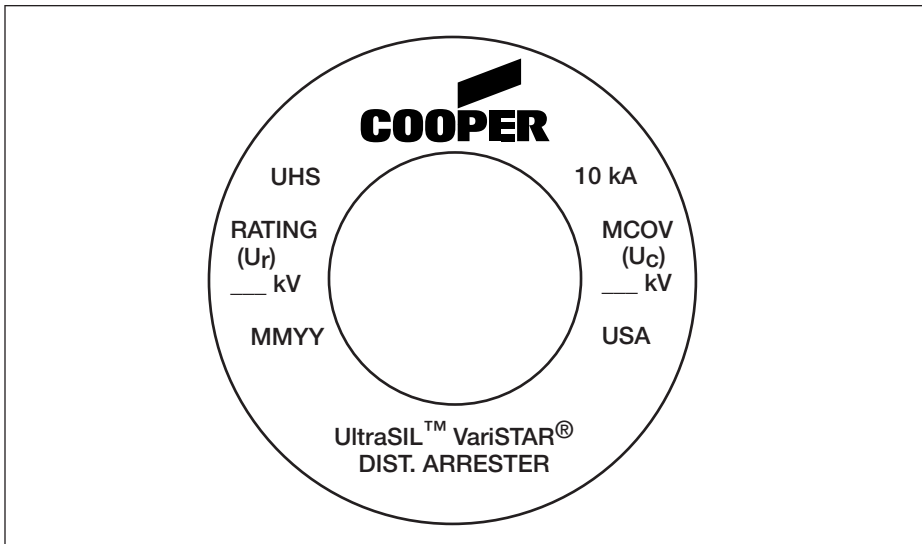


Figure 14.
IN = 10 kA, Class 1, UHS UltraSIL Nameplate – stamped in stainless steel top cap.

<p>VARISTAR® SURGE ARRESTER ULTRASIL™ TYPE UHS-ZnO IN = 10 kA CLASS 1 IEC 60099-4 P.R. = 20 kA sym</p> <p>(ENGLISH)</p>	<p>PARARRAYOS VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASE 1 CEI 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - EUROPA)</p>
<p>APARTARRAYOS VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASE 1 IEC 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - MEXICO)</p>	<p>DESC. DE SOBRET. VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASSE 1 IEC 60099-4 LdeS = 20 kA sim</p> <p>(PORTUGUÊS - EUROPA)</p>
<p>PARARRAYOS VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASE 1 IEC 60099-4 AdP = 20 kA sim</p> <p>(ESPAÑOL - AMERICAS)</p>	<p>OGRANICZNIK PRZEPIEC VARISTAR® ULTRASIL™ TYP UHS-ZnO IN = 10 kA KLASA 1 IEC 60099-4 Pr = 20 kA sym</p> <p>(POLSKI)</p>
<p>PÁRA-RAIOS VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASSE 1 IEC 60099-4 Sp = 20 kA sim</p> <p>(PORTUGUÊS - AMERICAS)</p>	<p>PARAFONDRE VARISTAR® MODELÉ ULTRASIL™ UHS-ZnO IN = 10 kA CLASSE 1 IEC 60099-4 LdP = 20 kA sym</p> <p>(FRANÇAIS)</p>
<p>VARISTAR® OVERSPENNINGSAVLEDER ULTRASIL™ TYPE UHS-ZnO IN = 10 kA KLASSE 1 IEC 60099-4 KORTSLUTTKAP = 20 kA sym</p> <p>(NORSK)</p>	<p>VARISTAR® YLIJÄNNITESUOJA ULTRASIL™ TYYPPI UHS-ZnO IN = 10 kA LUOKKA 1 IEC 60099-4 RTV = 20 kA sym</p> <p>(SUOMEKSI)</p>
<p>ALEXIKEPAYNO M.T. VARISTAR® TYPOS ULTRASIL™ UHS - ZNO IN = 10 kA IEC 60099-4 EKT PIES = 20 kA Sym</p> <p>(GREEK)</p>	<p>SCARICATORE M.T. VARISTAR® TIPO ULTRASIL™ UHS-ZnO IN = 10 kA CLASSE 1 IEC 60099-4 P.R. = 20 kA sym</p> <p>(ITALIANO)</p>
<p>VARISTAR® ОГРАНИЧИТЕЛЬ ПЕРЕНАПРЯЖЕНИЯ ULTRASIL™ ТИП ДИСКОВ. ЗНО Масса кг КЛАСС=10КАМ ЭКИЕЦ 60099-4СБРОС ДАВЛ.=20КА,СИМ</p> <p>(RUSSIAN)</p>	

Figure 14a.
IN = 10 kA, Class 1, UHS UltraSIL Arrester Auxiliary Nameplates.

TABLE 9

Product Information	
Design Test Report Summary 5 kA 10 kA	CP0504 CP0606
Installation and Service Instructions	IS235-35-1

